

0810H~0813H	2064~2067	dHA1~4 Alarm Parameters	The default is positive deviation alarm, but it can also be defined as an high limit alarm. This is one of the output group parameters. The output parameter group can either select the same numbered parameter group as the input or choose a different parameter group. The instrument has a total of 4 sets of output parameters.
0814H~0817H	2068~2071	dLA1~4 Alarm Parameters	The default is negative deviation alarm, but it can also be defined as a low limit alarm.
0818H~081BH	2072~2075	AAF1~4 Alarm Function Selection	AAF.0~AAF.4 select whether the input fault, HA alarm, LA alarm, dHA, and dLA alarms will be automatically reset or not. If set to 1, the alarm will not be automatically reset, and the customer needs to send a write command to clear the corresponding alarm status register to release the alarm action.
		AAF Detailed Explanation	Description
		Bit0	0: The alarm status automatically resets after the input signal error is cleared. 1: The alarm status does not automatically reset after the input signal error is cleared. To manually reset, write 0 to the corresponding bit of the alarm status parameter for the corresponding channel. For odd-numbered channels, write bit8=0 in the alarm status; for even-numbered channels, write bit0=0.
		Bit1	0: The alarm status automatically resets after the HA alarm is cleared. 1: The alarm status does not automatically reset after the HA alarm is cleared. To manually reset, write 0 to the corresponding bit of the alarm status parameter for the corresponding channel. For odd-numbered channels, write bit9=0 in the alarm status as 0; for even-numbered channels, write bit1=0.
		Bit2	0: The alarm status automatically resets after the LA alarm is cleared. 1: The alarm status does not automatically reset after the LA alarm is cleared. To manually clear the alarm, write 0 to the corresponding bit in the alarm status parameter for the respective channel. For odd-numbered channels, write bit10=0 in the alarm status; for even-numbered channels, write bit2=0.
		Bit3	0: The alarm status automatically resets after the dHA alarm is cleared. 1: The alarm status does not automatically reset after the dHA alarm is cleared. To manually clear the alarm, write 0 to the corresponding bit in the alarm status parameter for the respective channel. For odd-numbered channels, write bit11=0 in the alarm status; for even-numbered channels, write bit3=0.
		Bit4	0: The alarm status automatically resets after the dLA alarm is cleared. 1: The alarm status does not automatically reset after the dLA alarm is cleared. To manually clear the alarm, write 0 to the corresponding bit in the alarm status parameter for the respective channel. For odd-numbered channels, write bit10=0 in the alarm status; for even-numbered channels, write bit4=0.
		Bit5~bit7	Spare
081CH~081FH	2076~2079	HYS1~4 Hysteresis	The unit is the same as the measurement value. It is used as the hysteresis for alarms, ON/OFF control, and PID auto-tuning. However, auto-tuning can also use EHYS as the hysteresis by selecting it in Act.1.
0820H~0823H	2080~2083	OPL1~4 Output Lower Limit	Setting range 0~100, default as output lower limit. It can also be defined as the output value in the event of input faults/ overload.
0824H~0827H	2084~2087	OPH1~4 Output Upper Limit	Setting range: 0~105, used as the output upper limit.
0828H~082BH	2088~2091	OHE1~4 Segmented Power Limit Setting	OPH valid range, with the same unit as the measurement value. This is used to implement the segmented output limit function. When the measurement value is less than OHEF, the output is limited by OPH. When the measurement value exceeds OHEF, the output is not limited, i.e., it is 100%.
082CH~082FH	2092~2095	Act1~4 Control Function Selection	Act.0: Set to 0 for reverse action (heating), or 1 for direct action (cooling). Act.1: Set to 0 for using the HYS value of this parameter group as the hysteresis for self-tuning and ON/OFF control, set to 1 to use the global parameter EHYS as the hysteresis. Act.2: Set to 0 to force the output to 0 when an input fault occurs on this channel; set to 1 to force the output to OPL when an input fault occurs. Act.3: Set to 0 to define the output lower limit as OPL; set to 1 to fix the output lower limit at 0. Act.4: Set to 1 to force the output to the input fault state when a HA alarm occurs.
		ACT Detailed Explanation	Description
		Bit0	0: Reverse action mode (heating control) 1: Direct action mode (cooling control).
		Bit1	0: The At auto-tuning and (ON/OFF) bit control use the HYS value of this parameter group as the hysteresis. For example, if On01 = 2, then the hysteresis value for channel 2 will use HYS2. 1: The At auto-tuning and (ON/OFF) bit control use the global parameter EHYS as the hysteresis
		Bit2	0: When an input fault occurs on this channel, the output will be forced to 0 1: When an input fault occurs, the output will be forced to OPL
		Bit3	0: When an input fault occurs, the output will be forced to OPL 1: The output lower limit will be fixed at 0
		Bit4	0: The output will not be affected during the HA alarm 1: During the HA alarm, the output will also be forced to the same state as the input fault condition.
		Bit5~bit7	Spare
0830H~0833H	2096~2099	Shr1~4 Heating Slope Limit Value	Indicate the heating rate in degrees per minute. A value of 0 means no limit. When the SP value changes, the rate of change will be limited. Upon initial power-up or when control is started, the current measured value PV will be automatically set as the initial setpoint value. Additionally, if set AFC.3=1, any modification to the setpoint value SPXX will also automatically use the current measured value PV as the initial setpoint. Note this function does not apply to secondary control channels in cascade control mode. Note that the control cycle CTI value should be divisible by 60.0, such as 0.5, 0.8, 1.0, 1.2, 1.5, 2.0 seconds, etc. If other values are set, such as 0.9 or 1.1 seconds, there will be calculation errors in the heating slope value.
0834H~0837H	2100~2103	SrL1~4 Cooling Slope Limit Value	Indicate the cooling rate in degrees per minute. A value of 0 means no limit. The usage is the same as the Shr parameter.
0838H~083FH	2104~2111	Alternate address, please do not use	
0840H	2112	Addr Communication Address	Define the communication address of this device, with a range of 0~88. (For version D72, the Addr range can be set from 0~63, with effective addresses being from 0~31. The bAud is automatically adapted: when Addr is set to 0~31, the baud rate is 19200, and the actual address is also0~31. When Addr is set to 32~63, the baud rate is 38400 and the actual address is Addr minus 32. The actual address will be displayed in the D72 window.) Note: Address 0 is not recommended for use


0841H	2113	bAud Communication Baud Rate	Define the baud rate, the unit is 0.1K, setting range: 4.8K~115.2K.
0842H	2114	Adn Extended Input Loop Count	If the communication input interface of the local expansion module does not receive sufficient measurement values defined by the Adn input modules, a corresponding input fault alarm signal will be triggered. If the actual input exceeds the setpoint, it will be meaningless. This parameter is only used to define the communication input alarm prompt range and does not disable the measurement channel. To disable the measurement channel, the In parameter should be set.
0843H	2115	Func Local Operating Mode	This feature is not available in the current version.
0844H	2116	Ctn Control Loop Count	Indicate the number of control loops enabled. Each control loop occupies 10ms of processing time. If set to 96, the actual control cycle will be at least 0.96 seconds.
0845H	2117	Srun Run/ Stop Selection	Normally, the instrument operates in automatic control mode, but each channel can independently set the At parameter to turn off. If Srun is set to 9655, all PID channels will stop control output, and one command shutdown can be realized. If Srun is set to 15, the control mode remains active; however, when the power is turned off and then back on, the system will automatically enter the 9655 global stop state.
0846H	2118	Ctl	The control cycle is defined within the range of 0.1~5.0 seconds, with 0.1 seconds being the minimum cycle the system can achieve. For example, if the total number of control loops Ctn=16, the actual execution control cycle will be 0.16 seconds. In this version, the minimum control cycle cannot be lower than 0.1 seconds.
0847H	2119	ALAL Alarm Common Output Configuration (requires external alarm module expansion)	ALAL.0~4 define whether input fault, HA alarm, LA alarm, dHA, and dLA alarms will be output as a common alarm. Set to 0 for no output; set to 1 for output. Any alarm will trigger the global common alarm output AL0 action. The global common alarm output requires the alarm output terminal to be installed on the host.
0848H	2120	ALCH Alarm Independent Output Range Configuration (requires external alarm module expansion)	Define the start and end numbers of the independent alarm output channels for expansion. Although up to 5*97 alarm signals can be generated, note that the maximum number of extended alarm output channels is 256. For instance, if each channel requires 4 independent alarms, the difference between the output channel end number and the output channel start number should not exceed 64.
0849H	2121	ALbt Alarm Independent Output Configuration	ALbt.0~4 define whether input fault (including over-range, open circuit, communication disconnection, etc.), HA alarm, LA alarm, dHA, and dLA alarms are output. Set to 0 for no output; set to 1 for output. For example, if ALAL = 7, ALbt = 3, and ALCH = 16, the extended alarm output module will output 3 common alarms and 32 independent alarm signals. The output terminal numbers 1~3 will correspond to the common input alarm, high limit alarm, and low limit alarm; terminals 4~7 will sequentially correspond to channel 1 input error alarm, channel 1 HA alarm, channel 2 input error alarm, channel 2 HA alarm, and so on. For another example, if ALAL = 0, ALbt = 31, and ALCH = 616, the system will output 55 alarm signals, with 5 alarms for each of channels 6~16.
084AH	2122	AFa Functional Parameters Configuration A	AFA.0: Set to 0 for HA as the default high limit alarm, or 1 for positive deviation alarm. AFA.1: Set to 0 for LA as the default lower limit alarm, or 1 for negative deviation alarm. AFA.2: Set to 0 for dHA as the default positive deviation alarm, or 1 for hihg limit alarm. AFA.3: Set to 0 for dLA as the default negative deviation alarm, or 1 for low limit alarm. AFA.4: Set to 0 for LA as the default low limit alarm, or 1 for high limit alarm (this adds an additional high limit alarm). AFA.5: Set to 0 for HA and LA alarms to correspond to input channels, or 1 for HA and LA alarms to correspond to output channels (Note: do not use HA and LA as deviation alarms in this mode). AFA.6: Set to 0 for AL1 to be defined according to ALAL, or 1 for AL1 to be a global alarm AFA.7: Set to 0 for AL2 to be defined according to ALAL, or 1 for AL2 to be a global alarm
084BH	2123	AFB Function Parameter Configuration B	AFB.0 = 0: No multi-group PID functionality. AFB.0 = 1: Multi-group PID functionality is enabled. In this mode, there are 5 preset PID groups with automatic switching functionality. At this time, the maximum number of effective independent PID control channels is 16. The instrument divides the SV and PID parameter groups into 5*16 groups, where groups 1~16 correspond to the PID parameters currently used by channels 1~16. The subsequent 80 PID groups are arranged in order for each channel to use 5 groups. This means that each channel can preset up to 5 PID groups, which will automatically switch based on the current SF value. For example: If the setpoint SP1 is less than or equal to SP17, then P1, I1, and d1 will automatically be set to P17, I17, and d17. If SP1 is greater than SP17 but less than SP18, then P1, I1, and d1 will automatically be set to P18, I18, and d18. If SP1 is greater than SP18 but less than SP19, then P1, I1, and d1 will automatically be set to P19, I19, and d19. If SP1 is greater than all 5 preset SP values for switching, the PID parameters will remain unchanged. Similarly, channel 2 is associated with the PID group of channel 22~26, and so on.
084CH	2124	AFC Function Parameter Configuration C	AFC.0: Select communication parity bit. Set to 0 for no parity, or 1 for even parity. AFC.1=0: Choose linear output as 4~20mA or 2~10V; AFC.1=1: Choose current output as 0~20mA or 0~10V. AFC.2=0: No sensor backup function; AFC.2=1: Sensor backup function enabled. AFC.3=0: When using slope control, changes in the setpoint do not trigger the measurement value startup (PV START) function; AFC.3=1: When using slope control, changes in the setpoint trigger the measurement value startup function. Note that when using this function, the maximum number of control channels should not exceed 4. AFC.4=0: ADC converter provides better resistance to interference from a 50Hz power grid; AFC.4=1: ADC converter provides better resistance to interference from a 60Hz power grid. This setting is only applicable for countries using a 60Hz power grid. AFC.5=0: 0851H address master host status BIT0~BIT7 port status mode, where 1 indicates an output action and 0 indicates no action; AFC.5=1: 0851H address master host status BIT0~BIT7 port 0 indicates an action, and 1 indicates no action. AFC.6=0: When an external expansion module, such as YL-1016, is connected, output values are transmitted; AFC.6=1: When an external host is connected, PV measurement values are transmitted.
084DH	2125	Nonc	Nonc.0~5: Define the output as normally open (NO) or normally closed (NC) for input fault, HA alarm, LA alarm, dHA alarm, dLA alarm, and common alarm, respectively. 0: Normally open (closes when an alarm occurs). 1: Normally closed. Note that if the system is powered off, the relay is disconnected regardless of the settings

084EH	2126	EAF host sampling parameter configuration; note that this is only valid for the host's sampling rate. The sampling rate of the extended input module is configured by the extension module itself.	EAF=0: The main input refresh rate is automatically selected based on the CTI control cycle parameter. For thermocouples and voltage/current inputs, the fastest rate is 20ms; for RTD, it is 60ms. EAF=1: Fixed refresh rate of 20ms for each channel, with RTD inputs at 60ms. EAFAB=2: Fixed refresh rate of approximately 40ms, with RTD inputs at 120ms. EAFAB=3: Fixed refresh rate of approximately 80ms, with RTD inputs at 240ms.
084FH	2127	EHYS Additional Hysteresis	If a different hysteresis value is required for auto-tuning and ON/OFF control compared to the HYS alarm hysteresis, EHYS can be selected as the hysteresis value for auto-tuning and ON/OFF control through Act.1.
0850H	2128	dPt	The data range is 0~3, set the display decimal point position of the host operation panel. This setting is only for the convenience of displaying values on the basic operation panel and does not affect the data read by the host computer, the host computer program can handle the decimal point display by itself.
0851H	2129	Host Status	Read only, BIT0~5 indicates O1~O6 of the host computer, BIT11 corresponds to AL1, BIT12 corresponds to AL2 (For 8X88, BIT0~7 represent the status of the host's O1~O8, corresponding to 8 IO port statuses, respectively). 1 indicates output (can be defined by AFC.5). BIT8 is set to 1 to indicate a system fault, such as a memory data error, while BIT9 is set to 1 to signal the presence of a global alarm.
0852H	2130	Loc Parameter Locking	When Loc.5 is set to 0, all parameters can be written; when set to 1, writing parameters in the range of 0800H~08FFH is not allowed. Loc.6, when set to 0 and 1, respectively, indicates whether single-byte write commands are allowed or not. Loc.7, when set to 0 and 1, respectively, indicates whether multi-byte write commands are allowed or not. When writing is not allowed, the instrument will still return the command but will not actually modify the parameter.
0853H	2131	Instrument Model Characteristic Code	Read-only, indicate the instrument model.
0854H	2132	Machine Number High Bits	Read-only, indicate the high 4 digits of the machine number.
0855H	2133	Machine Number Low Bits	Read-only, indicate the lower 4 digits of the machine number.
0856H	2134	OPCH Output Start Channel	OPCH Local output start channel of this device: When set to 1, output 1 corresponds to channel 1. For example, if set to 5, output 1 corresponds to the output value of channel 5, OP5. This function is used in cases where channels 1~4 are used for calculation only and do not directly output.
0857H	2135	FL32 High-Resolution Measurement Filtering Constant	The unit is the sampling period, with a setting range of 0~999. This parameter applies high-resolution secondary filtering to the 32-bit data of 8 channels, improving the stability of the displayed data. This filtering does not apply to PID regulation. Typically, the workpiece being heated has a larger mass-to-volume ratio than the temperature sensor, so its thermal conductivity is slower than the sensor's response. By properly setting this filtering parameter, a more accurate representation of the actual internal temperature of the heated workpiece can be obtained.
0861H~088FH	2145~2191	Spare	
0898H~08FBH	2200~2099	Input Nonlinearity Calibration Table Data, etc.	Include input calibration curves, high-temperature furnace output limiting curves, etc., totaling 100 data.
0900H~	2305~	Temporarily Disable Read/ Write	

- Description:
- When developing the host computer software, ensure that the instrument responds to each valid command within 0~5ms (Note: this excludes data transmission time and the interval required by the MODBUS protocol, which should be calculated based on different baud rates and data lengths). The host computer must wait for the instrument to return data before sending a new command; otherwise, errors may occur. If the instrument does not respond within the maximum response time, the potential reasons could include invalid commands, incorrect instrument or parameter addresses, communication line faults, the instrument being powered off, or mismatched communication addresses. In such cases, the host computer should resend the command or skip that instrument's address.
 - Except for input errors, all other alarms on the instrument are generated based on the selected input values of the control channels. Typically, the input and control channel numbers are the same, but if they are different, e.g., if control channel 2 selects input channel 1 for the measurement value PV input, then the alarms for channel 2 will be based on the absolute value and control deviation of input channel 1, and will not relate to input channel 2. In particular, if two control channels select the same input channel for the measurement value, that channel's measurement value can have up to 8 related alarm settings at most. In addition, for input channels that are not selected, they should typically be disabled. Otherwise, the measurement behavior of that channel may affect the input error flags of the selected input channel associated with the output channel of the same number.
 - If any alarm condition is met, an additional global public alarm signal will be triggered. This alarm does not come from the extended alarm module but instead illuminates the host's own alarm indicator. It can be read through BIT9 of the 0851H. If the host has an optional alarm output module, this alarm can be output from the host.
 - The instrument will impose write range restrictions on parameter values in the address range 0800H~088FH. If an attempt is made to write data outside of this range, the error will still be executed, but the system will limit the range to prevent system malfunctions caused by writing out-of-range data.
 - Alarm Explanation
How to set up and drive AL1 and AL2, with related alarm parameters:
HA01~HA96: These are set as high limit absolute value alarms by default, but can be reconfigured as high deviation alarms.
LA01~LA96: These are set as low limit absolute value alarms by default, but can be reconfigured as low deviation alarms.
dHA1~dHA4: These are set as high deviation alarms by default, but can be reconfigured as high absolute value alarms.
dLA1~dLA4: These are set as low deviation alarms by default, but can be reconfigured as low absolute value alarms.
AAF1~4: Alarm function selection, which determines whether the output and status are reset after the alarm is automatically cleared.
HYS1~4: Hysteresis, the difference by which the alarm is cleared.
ALAL: Define whether each alarm will output
ALCH: Used when connecting an external alarm output module
ALbt: Also used when connecting an external alarm output module

5. Wiring Method

AI-6608D92 Input Wiring

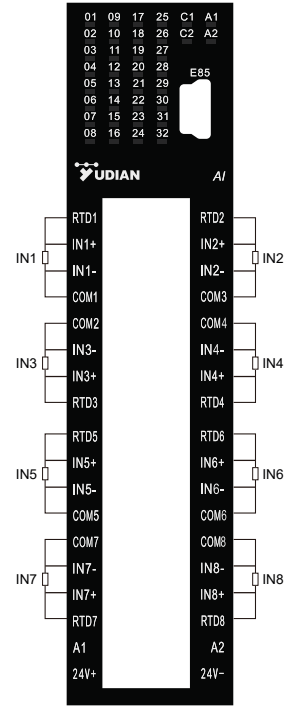

Indicator lights O1~O8 are used to indicate whether there is a fault in the corresponding input. C1 indicates 485 communication; C2 indicates 422 communication (PV transmission input). A1 represents a global alarm; A2 corresponds to the AL1 alarm output.

The input wiring is illustrated using Channel 1 as an example: Connect a pair of wires with low resistance between RTD1 and IN+; connect another pair between IN1- and COM1. A1 and A2 are used for alarm output. When equipped with the L21 module, the output is a dry contact, but the voltage in series must not exceed 28V. When equipped with the G module, A1 serves as the positive terminal and A2 as the negative terminal, providing a 12V, 30mA output signal.

24V+ and 24V- are the power supply terminals on the front. The instrument can also be powered via the base power terminals.



Follow us on the WeChat official account for technical support